



TECHNICAL GUIDE

SPLIT-SYSTEM AIR CONDITIONERS

13 SEER – R-410A – 3 PHASE

MODELS:
YCJD30 THRU 60
(2.5 THRU 5 NOMINAL TONS)



Due to continuous product improvement, specifications are subject to change without notice.

Visit us on the web at www.york.com

Additional rating information can be found at
www.ahridirectory.org

WARRANTY

Standard 1-year limited parts warranty.
Standard 5-year limited compressor warranty.

DESCRIPTION

The 13 SEER Series unit is the outdoor part of a versatile climate system. It is designed with a matching indoor coil component from Johnson Controls Unitary Products. Available for typical applications this climate system is supported with accessories and documents to serve specific functions.

FEATURES

- **Quality Condenser Coils** - The coil is constructed of aluminum microchannel tubing and enhanced aluminum fins for increased efficiency.
- **Protected Compressor** - The compressor is internally protected against high pressure, temperature, and externally by a factory installed high pressure switch. This is accomplished by the simultaneous operation of high pressure relief valve and a temperature sensor which protects the compressor if undesirable operating conditions occur. A liquid line filter-drier further protects the compressor.
- **Durable Finish** - The cabinet is made of pre-painted steel. The pre-treated galvanized steel provides a better paint to steel bond, which resists corrosion and rust creep. Special primer formulas and matted-textured finish insure less fading when exposed to sunlight.
- **Lower Installed Cost** - Installation time and costs are reduced by easy power and control wiring connections. Available in sweat connect models only. The unit contains enough refrigerant for matching indoor coils and 15 feet of interconnecting piping. The small base dimension means less space is required on the ground or roof.
- **Top Discharge** - The warm air from the top mounted fan is blown up away from the structure and any landscaping. This allows compact location on multi-unit applications.
- **Low Operating Sound Level** - The upward air flow carries the normal operating noise away from the living area. The rigid top panel effectively isolates any motor sound. Isolator mounted compressor and the rippled fins of the condenser coil muffle the normal fan motor and compressor operating sounds.
- **Low Maintenance** - Long life permanently lubricated motor-bearings need no annual servicing.
- **Easy Service Access** - Fully exposed refrigerant connections, and a single panel covering the electrical controls make for easy servicing of the unit.
- **Secured Service Valves** - Secured re-usable service valves are provided on both the liquid and vapor sweat connections for ease of evacuating and charging.
- **U.L. and C.U.L. Listed** - approved for outdoor application.
- **Agency Listed** - U.L. and C.U.L. listed - approved for outdoor application. The unit is certified in accordance with the Unitary Small Equipment certification program, which is based on ARI Standard 210/240.

Physical and Electrical Data


| MODEL | YCJD30 S43S3 | YCJD36 S43S3 | YCJD42 S43S3 | YCJD48 S43S3 | YCJD60 S43S3 | YCJD30 S44S3 | YCJD36 S44S3 | YCJD42 S44S3 | YCJD48 S44S3 | YCJD60 S44S3 | |
|---|---------------------------|-----------------|-----------------|-----------------|-----------------|-----------------------|-----------------|-----------------|-----------------|-----------------|-----|
| Unit Supply Voltage | 208-230V, 3 ϕ , 60Hz | | | | | 460V, 3 ϕ , 60Hz | | | | | |
| Normal Voltage Range ¹ | 187 to 252 | | | | | 432 to 532 | | | | | |
| Minimum Circuit Ampacity | 11.6 | 12.3 | 16.3 | 15.5 | 23.5 | 6.0 | 6.4 | 7.3 | 7.2 | 11.6 | |
| Max. Overcurrent Device Amps ² | 15 | 20 | 25 | 25 | 40 | 15 | 15 | 15 | 15 | 20 | |
| Min. Overcurrent Device Amps ³ | 15 | 15 | 20 | 20 | 25 | 15 | 15 | 15 | 15 | 15 | |
| Compressor Type | Recip | Recip | Recip | Recip | Scroll | Recip | Recip | Recip | Recip | Scroll | |
| Compressor Amps | Rated Load | 8.1 | 8.6 | 11.8 | 11.2 | 17.6 | 4.2 | 4.5 | 5.2 | 5.1 | 8.6 |
| | Locked Rotor | 63 | 68 | 88 | 88 | 120 | 30 | 34 | 44 | 44 | 70 |
| Crankcase Heater | No | No | No | No | No | No | No | No | No | No | |
| Fan Motor Amps | Rated Load | 1.4 | 1.5 | 1.5 | 1.5 | 1.5 | 0.8 | 0.8 | 0.8 | 0.8 | |
| | Fan Diameter Inches | 17.5 | 22 | 22 | 22 | 22 | 17.5 | 22 | 22 | 22 | |
| Fan Motor | Rated HP | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 | 1/4 | |
| | Nominal RPM | 1100 | 850 | 850 | 850 | 850 | 1100 | 850 | 850 | 850 | |
| | Nominal CFM | 2050 | 3200 | 2950 | 2950 | 3600 | 2050 | 3200 | 2950 | 2950 | |
| Coil | Face Area Sq. Ft. | 9.6 | 13.07 | 14.16 | 14.16 | 18.68 | 9.6 | 13.07 | 14.16 | 14.16 | |
| | Rows Deep | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| | Fin / Inches | 23 | 23 | 23 | 23 | 23 | 23 | 23 | 23 | 23 | |
| Liquid Line Set OD (Field Installed) | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | |
| Vapor Line Set OD (Field Installed) | 3/4 | 3/4 | 7/8 | 7/8 | 7/8 | 3/4 | 3/4 | 7/8 | 7/8 | 7/8 | |
| Unit Charge (Lbs. - Oz.) ⁴ | 3 - 14 | 4 - 9 | 4 - 5 | 4 - 9 | 5 - 6 | 3 - 14 | 4 - 9 | 4 - 5 | 4 - 9 | 5 - 6 | |
| Charge Per Foot, Oz. | 0.62 | 0.62 | 0.67 | 0.67 | 0.67 | 0.62 | 0.62 | 0.67 | 0.67 | 0.67 | |
| Operating Weight Lbs. | 131 | 145 | 173 | 173 | 195 | 131 | 145 | 173 | 173 | 195 | |

1. Rated in accordance with ARI Standard 110, utilization range "A".

2. Dual element fuses or HACR circuit breaker. Maximum allowable overcurrent protection.

3. Dual element fuses or HACR circuit breaker. Minimum recommended overcurrent protection.

4. The Unit Charge is correct for the outdoor unit, matched indoor coil and 15 feet of refrigerant tubing. For tubing lengths other than 15 feet, add or subtract the amount of refrigerant, using the difference in length multiplied by the per foot value. If line exceeds 25 feet, you may refer to publications software 036-68001-001 for proper line sizing.

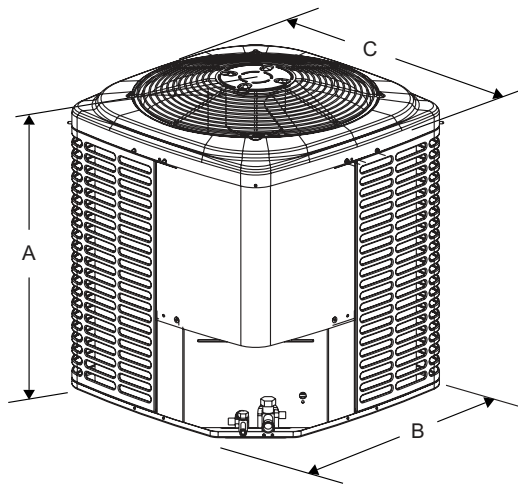

All dimensions are in inches. They are subject to change without notice. Certified dimensions will be provided upon request.

| Unit Model | Dimensions (Inches) | | | Refrigerant Connection Service Valve Size | |
|------------|---------------------|--------|--------|---|-------|
| | A ¹ | B | C | Liquid | Vapor |
| 30 | 28 | 23-1/2 | 23-1/2 | 3/8" | 3/4" |
| 36 | 28 | 29 | 29 | | |
| 42 | 30 | 29 | 29 | | 7/8" |
| 48 | 30 | 29 | 29 | | |
| 60 | 32 | 33-5/8 | 33-5/8 | | |

1. Including Fan Guard.

| System Charge for Various Matched Systems | | | | | |
|---|-----------------------|-----------------|-----------------|-----------------|-----------------|
| Outdoor Unit | YCJD30S4(3,4)S3 | YCJD36S4(3,4)S3 | YCJD42S4(3,4)S3 | YCJD48S4(3,4)S3 | YCJD60S4(3,4)S3 |
| Required Orifice or TXV ^{1,2} | 0.061/4F1 | 0.065/4G1 | 0.075/4G1 | 0.073/4H1 | 0.087/4J1 |
| Factory Charge, lbs-oz | 3 - 14 | 4 - 9 | 4 - 5 | 4 - 9 | 5 - 6 |
| Indoor Coil ^{3,4} | Additional Charge, oz | | | | |
| AHP30 | 0 | – | – | – | – |
| AHP36 | 2 | 0 | – | – | – |
| AHP42 | – | 0 | 0 | – | – |
| AHP/SHP60 | – | – | – | 0 | 0 |
| AHX30 | 0 | – | – | – | – |
| AHX36 | 2 | 0 | – | – | – |
| AHX42 | – | 8 | 2 | – | – |
| AHX48 | – | – | – | 0 | – |
| AHX60 | – | – | – | – | 4 |
| AV*36 | 2 | 0 | – | – | – |
| AV/SV*48 | – | – | TXV + 2 | 0 | – |
| AV/SV*60 | – | – | TXV + 2 | 0 | 0 |
| F4FP024 | – | – | – | – | – |
| F4FP036 | – | – | – | – | – |
| F4FP040 | 0 | – | – | – | – |
| F5FP048 | – | 8 | 2 | 4 | – |
| F5FP060 | – | – | – | 0 | 0 |
| F6FP030 | 0 | – | – | – | – |
| F6FP036 | 0 | – | – | – | – |
| F6FP042 | – | 8 | 2 | – | – |
| F6FP048 | – | – | T2 | 0 | – |
| F6FP060 | – | – | – | – | 4 |
| FC/MC/PC32 | 0 | – | – | – | – |
| FC/MC/PC35 | 0 | – | – | – | – |
| FC/MC/PC37 | 2 | 0 | – | – | – |
| FC/MC/PC43 | 2 | 0 | 0 | – | – |
| FC/MC/PC48 | – | 8 | 2 | 4 | – |
| FC/MC/PC60 | – | – | – | 0 | 0 |
| FC/MC62 | – | – | – | – | 4 |
| HC36 | 0 | – | – | – | – |
| HC42 | 2 | 0 | 0 | – | – |
| HC60 | – | – | – | – | 0 |
| UC48 | – | 8 | 2 | 4 | – |
| UC60 | – | – | – | 0 | 0 |

FOOTNOTES:

1. For applications requiring a TXV use 1TVM series kit.
2. Approved orifice shipped with outdoor unit.
3. Systems matched with furnace or air handlers not equipped with blower-off delays may require blower Time Delay Kit 2FD06700224.
4. PC coils cannot be used in downflow or horizontal applications. FC coils cannot be used in horizontal applications.

PROCEDURES:

1. Unit factory charge listed on the unit nameplate includes refrigerant for the condenser, the smallest evaporator and 15 feet of interconnecting line tubing.
2. Verify the TXV and additional charge required for specific evaporator coil in the system using the above table.
3. Additional charge for the amount of interconnecting line tubing greater than 15 feet at the rate specified in Physical and Electrical Data Table.
4. For orifice or TXV matches requiring additional charge, the refrigerant needs to be weighed in for specific coil match and lineset length.
5. Permanently mark the unit nameplate with the total system charge. Total System Charge = Base Charge (as shipped) + adder for evaporator + adder for line set.

COOLING CAPACITY - With Air Handler Coils

| UNIT MODEL | AIR HANDLER | | COIL MODEL ¹ | COOLING | | | | |
|---|-------------|----|----------------------------|--------------|---------|-------|-------|-------|
| | MODEL | W | | RATED CFM | NET MBH | | SEER | EER |
| | | | | | TOTAL | SENS. | | |
| 13 SEER AC WITH MA | | | | | | | | |
| YCJD30S4(3,4)S3 | MA12B | 17 | FC/MC35B | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | MA12B | 17 | FC/MC43B | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| YCJD36S4(3,4)S3 | MA12B | 17 | FC/MC43B | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| | MA14D | 24 | FC/MC48D | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| YCJD42S4(3,4)S3 | MA16C | 21 | FC/MC43C | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| | MA14D | 24 | FC/MC48D | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| | MA16C | 21 | FC/MC48C | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| YCJD48S4(3,4)S3 | MA16C | 21 | FC/MC48C | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | MA20D | 24 | FC/MC48D | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | MA16C | 21 | FC60C | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | MA20D | 24 | FC/MC60D | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| YCJD60S4(3,4)S3 | MA20D | 24 | FC/MC60D | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |
| | MA20D | 24 | FC/MC62D | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |
| 13 SEER AC WITH AHP / SHP / AHX / F*FP | | | | | | | | |
| YCJD30S4(3,4)S3 | AHP30 | 17 | - | 1015 | 29.0 | 21.0 | 13.00 | 11.00 |
| | AHP36 | 21 | - | 1040 | 29.0 | 21.0 | 13.00 | 11.00 |
| | AHX30 | 17 | - | 1025 | 29.4 | 22.2 | 14.00 | 11.75 |
| | AHX36 | 21 | - | 1005 | 30.0 | 22.3 | 14.50 | 12.00 |
| | F4FP040 | 18 | - | 1050 | 29.0 | 21.0 | 13.00 | 11.00 |
| | F6FP030 | 17 | - | 1035 | 29.2 | 21.6 | 13.50 | 11.40 |
| | F6FP036 | 21 | - | 980 | 29.4 | 21.4 | 14.00 | 12.00 |
| YCJD36S4(3,4)S3 | AHP36 | 21 | - | 1235 | 35.0 | 24.8 | 13.00 | 11.00 |
| | AHP42 | 21 | - | 1255 | 35.0 | 24.8 | 13.00 | 11.00 |
| | AHX36 | 21 | - | 1225 | 35.2 | 25.0 | 13.50 | 11.50 |
| | AHX42 | 21 | - | 1190 | 35.4 | 25.2 | 14.00 | 11.80 |
| | F5FP048 | 24 | - | 1235 | 35.0 | 24.8 | 13.00 | 11.00 |
| | F6FP042 | 21 | - | 1290 | 35.8 | 25.8 | 13.50 | 11.50 |
| YCJD42S4(3,4)S3 | AHP42 | 21 | - | 1485 | 41.0 | 29.2 | 13.00 | 11.00 |
| | AHX42 | 21 | - | 1395 | 42.0 | 29.9 | 14.50 | 12.00 |
| | F5FP048 | 24 | - | 1455 | 41.0 | 29.2 | 13.00 | 11.00 |
| | F6FP042 | 21 | - | 1455 | 42.0 | 30.1 | 14.00 | 11.75 |
| | F6FP048 | 24 | - | 1380 | 41.5 | 29.4 | 13.50 | 11.70 |
| YCJD48S4(3,4)S3 | AHP/SHP48 | 24 | - | 1675 | 48.0 | 34.4 | 13.00 | 11.00 |
| | AHP/SHP60 | 24 | - | 1600 | 48.0 | 35.0 | 13.50 | 11.00 |
| | AHX48 | 24 | - | 1660 | 48.0 | 35.4 | 13.50 | 11.50 |
| | F5FP048 | 24 | - | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | F5FP060 | 24 | - | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | F6FP048 | 24 | - | 1625 | 47.0 | 34.8 | 13.00 | 11.30 |
| YCJD60S4(3,4)S3 | AHP/SHP60 | 24 | - | 1850 | 57.0 | 38.5 | 13.00 | 11.00 |
| | AHX60 | 24 | - | 1905 | 58.5 | 40.0 | 13.50 | 11.50 |
| | F5FP060 | 24 | - | 1900 | 57.0 | 38.5 | 13.00 | 11.00 |
| | F6FP060 | 24 | - | 1710 | 57.5 | 39.0 | 13.50 | 11.50 |
| 13 SEER AC WITH AV/SV | | | | | | | | |
| YCJD30S4(3,4)S3 | AV*36 | 21 | - | 960 | 30.0 | 21.8 | 14.50 | 12.00 |
| YCJD36S4(3,4)S3 | AV*36 | 21 | - | 1190 | 35.0 | 25.2 | 13.50 | 11.50 |
| YCJD42S4(3,4)S3 | AV*48 | 24 | - | 1385 | 42.0 | 29.8 | 14.00 | 12.00 |
| | AV*60 | 24 | - | 1360 | 42.0 | 29.8 | 14.00 | 12.00 |
| YCJD48S4(3,4)S3 | AV*48 | 24 | - | 1625 | 48.0 | 35.0 | 13.50 | 11.50 |
| | AV*60 | 24 | - | 1560 | 48.0 | 35.0 | 13.50 | 11.50 |
| YCJD60S4(3,4)S3 | AV*60 | 24 | - | 1730 | 57.0 | 39.0 | 13.50 | 11.50 |

Rated in accordance with DOE test procedures (Federal Register 12-27-79 and 3-18-88) and ARI Standards 210.

Cooling MBH based on 80°F entering air temperature, 50% RH, and rated air flow.

EER (Energy Efficiency Ratio) is the total cooling output in BTU's at 95°F outdoor ambient divided by the total electric power in watt-hours at those conditions.

SEER (Seasonal Energy Efficiency Ratio) is the total cooling output in BTU's during a normal annual usage period for cooling divided by the total electric power input in watt-hours during the same period.

1. MC coils available with a factory installed horizontal drain pan. See price pages for specific model number.

— = Not applicable.

COOLING CAPACITY - Upflow, Downflow & Horizontal Furnaces and Coils

| UNIT MODEL | FURNACE** | | COIL MODEL | COOLING | | | | |
|-----------------|--------------------------|-------|------------|--------------|---------|-------|-------------------|-------|
| | CFM RANGE (Min.-max.) | W | | RATED CFM | NET MBH | | SEER ¹ | EER |
| | | | | | TOTAL | SENS. | | |
| YCJD30S4(3,4)S3 | 800 - 1200 | 14 | FC/MC/PC32 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | 800 - 1200 | 17,21 | FC/MC/PC35 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | 800 - 1200 | 14 | FC/MC/PC37 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | 800 - 1200 | 17,21 | FC/MC/PC43 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | 800 - 1200 | 17 | HC36 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| | 800 - 1200 | 21 | HC42 | 1000 | 29.0 | 21.0 | 13.00 | 11.00 |
| YCJD36S4(3,4)S3 | 1000 - 1400 | 14 | FC/MC/PC37 | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| | 1000 - 1400 | 17,21 | FC/MC/PC43 | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| | 1000 - 1400 | 21,24 | FC/MC/PC48 | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| | 1000 - 1400 | 21 | HC42 | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| | 1000 - 1400 | 21,24 | UC48 | 1200 | 35.0 | 24.8 | 13.00 | 11.00 |
| YCJD42S4(3,4)S3 | 1200 - 1600 | 17,21 | FC/MC/PC43 | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| | 1200 - 1600 | 21,24 | FC/MC/PC48 | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| | 1200 - 1600 | 21 | HC42 | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| | 1200 - 1600 | 21,24 | UC48 | 1400 | 42.0 | 29.2 | 13.00 | 11.00 |
| YCJD48S4(3,4)S3 | 1400 - 1800 | 21,24 | FC/MC/PC48 | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | 1400 - 1800 | 21,24 | FC/MC/PC60 | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | 1400 - 1800 | 24 | HC60 | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | 1400 - 1800 | 21,24 | UC48 | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| | 1400 - 1800 | 21,24 | UC60 | 1600 | 48.0 | 34.4 | 13.00 | 11.00 |
| YCJD60S4(3,4)S3 | 1600 - 2000 | 21,24 | FC/MC/PC60 | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |
| | 1600 - 2000 | 24 | FC/MC62 | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |
| | 1600 - 2000 | 24 | HC60 | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |
| | 1600 - 2000 | 21,24 | UC60 | 1800 | 57.0 | 38.5 | 13.00 | 11.00 |

1. Requires a 2FD06700224 Blower Time Delay unless a standard furnace is equipped with one.

** Refer to Quick Selection Chart for specific furnace match-up.

COOLING CAPACITY - With High Efficiency Motor Furnaces

| UNIT MODEL | FURNACE MODEL | COIL MODEL ¹ | W | COOLING | | | | |
|--|---------------|-------------------------|------|-----------|---------|-------|-------|-------|
| | | | | RATED CFM | Net MBH | | SEER | EER |
| | | | | | TOTAL | SENS. | | |
| 13 SEER HP WITH VARIABLE SPEED FURNACES² | | | | | | | | |
| YCJD30S4(3,4)S3 | T*(8,L)X*A12 | FC/MC/PC32A | 14 | 970 | 29.2 | 21.4 | 13.20 | 11.00 |
| | T*(8,L)X*B12 | FC/MC/PC35B | 17 | 1120 | 30.0 | 22.8 | 14.00 | 11.50 |
| | T*(8,L)X*C16 | FC/MC/PC35C | 21 | 1105 | 30.0 | 22.8 | 14.00 | 12.00 |
| | T*(8,L)X*C20 | FC/MC/PC35C | 21 | 850 | 28.8 | 20.6 | 14.00 | 12.00 |
| | T*9X*B12 | FC/MC/PC35B | 17 | 1085 | 29.8 | 22.8 | 14.00 | 12.00 |
| | T*9X*C16 | FC/MC/PC35C | 21 | 1075 | 29.8 | 22.4 | 14.00 | 12.00 |
| | T*(8,L)X*A12 | FC/MC/PC37A | 14 | 1105 | 30.0 | 22.9 | 13.80 | 11.50 |
| | T*(8,L)X*B12 | FC/MC/PC43B | 17 | 1125 | 30.0 | 22.9 | 14.00 | 12.00 |
| | T*(8,L)X*C16 | FC/MC/PC43C | 21 | 710 | 28.2 | 19.3 | 14.00 | 12.00 |
| | T*(8,L)X*C20 | FC/MC/PC43C | 21 | 870 | 29.6 | 21.2 | 14.00 | 12.00 |
| | T*9X*B12 | FC/MC/PC43B | 17 | 1095 | 30.0 | 22.9 | 13.80 | 11.50 |
| | T*9X*C16 | FC/MC/PC43C | 21 | 1055 | 30.0 | 22.9 | 14.00 | 12.00 |
| T*9X*C20 | FC/MC/PC43C | 21 | 720 | 28.2 | 19.3 | 14.00 | 12.00 | |
| YCJD36S4(3,4)S3 | T*(8,L)X*A12 | FC/MC/PC37A | 14 | 1290 | 35.2 | 25.4 | 13.30 | 11.25 |
| | T*(8,L)X*B12 | FC/MC/PC43B | 17 | 1300 | 35.2 | 25.4 | 13.30 | 11.25 |
| | T*(8,L)X*C16 | FC/MC/PC43C | 21 | 1175 | 35.2 | 24.8 | 14.00 | 11.50 |
| | T*(8,L)X*C20 | FC/MC/PC43C | 21 | 1250 | 35.6 | 25.6 | 13.80 | 11.70 |
| | T*9X*B12 | FC/MC/PC43B | 17 | 1270 | 35.2 | 25.4 | 13.25 | 11.25 |
| | T*9X*C16 | FC/MC/PC43C | 21 | 1260 | 35.4 | 25.4 | 13.45 | 11.40 |
| | T*9X*C20 | FC/MC/PC43C | 21 | 1185 | 35.0 | 24.6 | 13.55 | 11.40 |
| | T*(8,L)X*C16 | FC/MC/PC48C | 21 | 1185 | 35.6 | 25.2 | 14.00 | 11.50 |
| | T*(8,L)X*C20 | FC/MC/PC48C | 21 | 1270 | 35.8 | 25.8 | 14.00 | 11.50 |
| | T*9X*C16 | FC/MC/PC48C | 21 | 1280 | 35.8 | 25.8 | 13.70 | 11.50 |
| | T*9X*C20 | FC/MC/PC48C | 21 | 1205 | 35.4 | 25.0 | 13.70 | 11.50 |
| | T*9X*D20 | FC/MC/PC48D | 24 | 1240 | 35.4 | 25.0 | 13.70 | 11.50 |
| | T*(8,L)X*C16 | UC48C | 21 | 1185 | 34.2 | 24.8 | 13.50 | 11.50 |
| | T*(8,L)X*C20 | UC48C | 21 | 1300 | 34.8 | 25.4 | 13.50 | 11.50 |
| | T*9X*C16 | UC48C | 21 | 1280 | 34.6 | 24.8 | 13.15 | 11.20 |
| | T*9X*C20 | UC48C | 21 | 1205 | 34.0 | 24.6 | 13.25 | 11.20 |
| T*9X*D20 | UC48D | 24 | 1240 | 34.0 | 24.6 | 13.30 | 11.25 | |
| YCJD42S4(3,4)S3 | T*(8,L)X*B12 | FC/MC/PC43B | 17 | 1300 | 42.0 | 29.0 | 13.50 | 11.50 |
| | T*(8,L)X*C16 | FC/MC/PC43C | 21 | 1475 | 42.0 | 29.9 | 13.50 | 11.50 |
| | T*(8,L)X*C20 | FC/MC/PC43C | 21 | 1415 | 42.0 | 29.5 | 13.50 | 11.50 |
| | T*9X*B12 | FC/MC/PC43B | 17 | 1270 | 42.0 | 29.0 | 13.50 | 11.50 |
| | T*9X*C16 | FC/MC/PC43C | 21 | 1410 | 42.0 | 29.6 | 13.30 | 11.00 |
| | T*9X*C20 | FC/MC/PC43C | 21 | 1400 | 42.0 | 29.6 | 13.50 | 11.00 |
| | T*(8,L)X*C16 | FC/MC/PC48C | 21 | 1360 | 42.0 | 29.5 | 13.80 | 11.50 |
| | T*(8,L)X*C20 | FC/MC/PC48C | 21 | 1475 | 42.0 | 30.1 | 14.00 | 11.50 |
| | T*9X*C16 | FC/MC/PC48C | 21 | 1425 | 42.0 | 29.3 | 13.50 | 11.50 |
| | T*9X*C20 | FC/MC/PC48C | 21 | 1420 | 42.0 | 29.3 | 13.50 | 11.50 |
| | T*9X*D20 | FC/MC/PC48D | 24 | 1435 | 42.0 | 29.7 | 13.50 | 11.50 |
| | T*(8,L)X*C16 | UC48C | 21 | 1400 | 42.0 | 29.4 | 13.50 | 11.00 |
| | T*(8,L)X*C20 | UC48C | 21 | 1515 | 42.0 | 30.0 | 13.50 | 11.00 |
| | T*9X*C16 | UC48C | 21 | 1425 | 41.5 | 29.2 | 13.30 | 11.00 |
| | T*9X*C20 | UC48C | 21 | 1420 | 42.0 | 29.4 | 13.20 | 11.00 |
| T*9X*D20 | UC48D | 24 | 1435 | 42.0 | 29.4 | 13.40 | 11.00 | |

For Notes See Page 7.

COOLING CAPACITY - With High Efficiency Motor Furnaces (Continued)

| UNIT MODEL | FURNACE MODEL | COIL MODEL ¹ | W | COOLING | | | | |
|--|---------------|-------------------------|----|-----------|---------|-------|-------|-------|
| | | | | RATED CFM | Net MBH | | SEER | EER |
| | | | | | TOTAL | SENS. | | |
| 13 SEER HP WITH VARIABLE SPEED FURNACES² | | | | | | | | |
| YCJD48S4(3,4)S3 | T*(8,L)X*C16 | FC/MC/PC48C | 21 | 1600 | 48.0 | 34.4 | 13.30 | 11.00 |
| | T*(8,L)X*C20 | FC/MC/PC48C | 21 | 1660 | 48.0 | 34.4 | 13.20 | 11.00 |
| | T*9X*C16 | FC/MC/PC48C | 21 | 1565 | 48.0 | 34.8 | 13.10 | 11.00 |
| | T*9X*C20 | FC/MC/PC48C | 21 | 1615 | 48.0 | 34.4 | 13.20 | 11.00 |
| | T*9X*D20 | FC/MC/PC48D | 24 | 1635 | 48.0 | 34.8 | 13.20 | 11.00 |
| | T*(8,L)X*C16 | FC/PC60C | 21 | 1605 | 48.0 | 34.6 | 13.30 | 11.00 |
| | T*(8,L)X*C20 | FC/MC/PC60D | 21 | 1595 | 48.0 | 34.8 | 13.30 | 11.00 |
| | T*9X*C16 | FC/PC60C | 21 | 1575 | 48.0 | 34.6 | 13.30 | 11.00 |
| | T*9X*C20 | FC/PC60C | 21 | 1625 | 47.0 | 34.6 | 13.40 | 11.00 |
| | T*9X*D20 | FC/MC/PC60D | 24 | 1490 | 47.5 | 33.8 | 13.20 | 11.00 |
| | T*9X*C16 | FC/PC60C | 21 | 1575 | 47.0 | 33.8 | 13.10 | 11.00 |
| | T*9X*C20 | FC/PC60C | 21 | 1625 | 47.0 | 33.8 | 13.10 | 11.00 |
| YCJD60S4(3,4)S3 | T*(8,L)X*C16 | FC/PC60C | 21 | 1605 | 56.5 | 37.8 | 13.50 | 11.00 |
| | T*(8,L)X*C20 | FC/MC/PC60D | 21 | 1690 | 57.0 | 37.8 | 13.50 | 11.00 |
| | T*9X*C16 | FC/PC60C | 21 | 1575 | 56.0 | 37.8 | 13.30 | 11.00 |
| | T*9X*C20 | FC/PC60C | 21 | 1560 | 56.0 | 37.8 | 13.30 | 11.00 |
| | T*9X*D20 | FC/MC/PC60D | 24 | 1630 | 56.5 | 37.8 | 13.30 | 11.00 |
| | T*9X*C20 | FC/MC/PC60D | 21 | 1645 | 56.5 | 37.8 | 13.30 | 11.00 |
| | T*(8,L)X*C20 | FC/MC62D | 21 | 1665 | 57.0 | 37.8 | 13.50 | 11.00 |
| | T*(8,L)X*C16 | UC60C | 21 | 1640 | 56.0 | 37.2 | 13.00 | 11.00 |
| | T*(8,L)X*C20 | UC60D | 21 | 1735 | 56.5 | 38.5 | 13.00 | 11.00 |
| | T*9X*C16 | FC/PC60C | 21 | 1575 | 56.0 | 37.2 | 13.00 | 11.00 |
| | T*9X*C20 | FC/PC60C | 21 | 1560 | 56.0 | 37.2 | 13.00 | 11.00 |
| | T*9X*D20 | UC60D | 24 | 1630 | 56.0 | 37.2 | 13.00 | 11.00 |
| | T*(8,L)X*C20 | UC60D | 21 | 1735 | 56.5 | 38.5 | 13.00 | 11.00 |
| | T*9X*C20 | UC60D | 21 | 1645 | 56.0 | 37.2 | 13.00 | 11.00 |

1. MC coils available with a factory installed horizontal drain pan. See price pages for specific model number.

2. Variable speed furnaces have B.O.D (Blower on Delay) standard.

ACCESSORIES

Refer to Price Manual for specific model numbers.

Off Cycle Timer Delay - Provides a 5-minute off cycle to prevent rapid recycling of the compressor.


Thermostats - Compatible thermostat controls are available through accessory sourcing. For optimum performance and installation, refer to the UPGNET "Low Voltage Wiring Diagram" document to select and apply controls.

SOUND POWER RATINGS*


| UNIT MODEL | (dBA) | |
|------------|-------|------|
| | 230V | 460V |
| 30 | 76 | 76 |
| 36 | 76 | 76 |
| 42 | 77 | 76 |
| 48 | 77 | 77 |
| 60 | 78 | 78 |

* Rated in accordance with ARI 270-95 Standards.

TYPICAL INSTALLATION

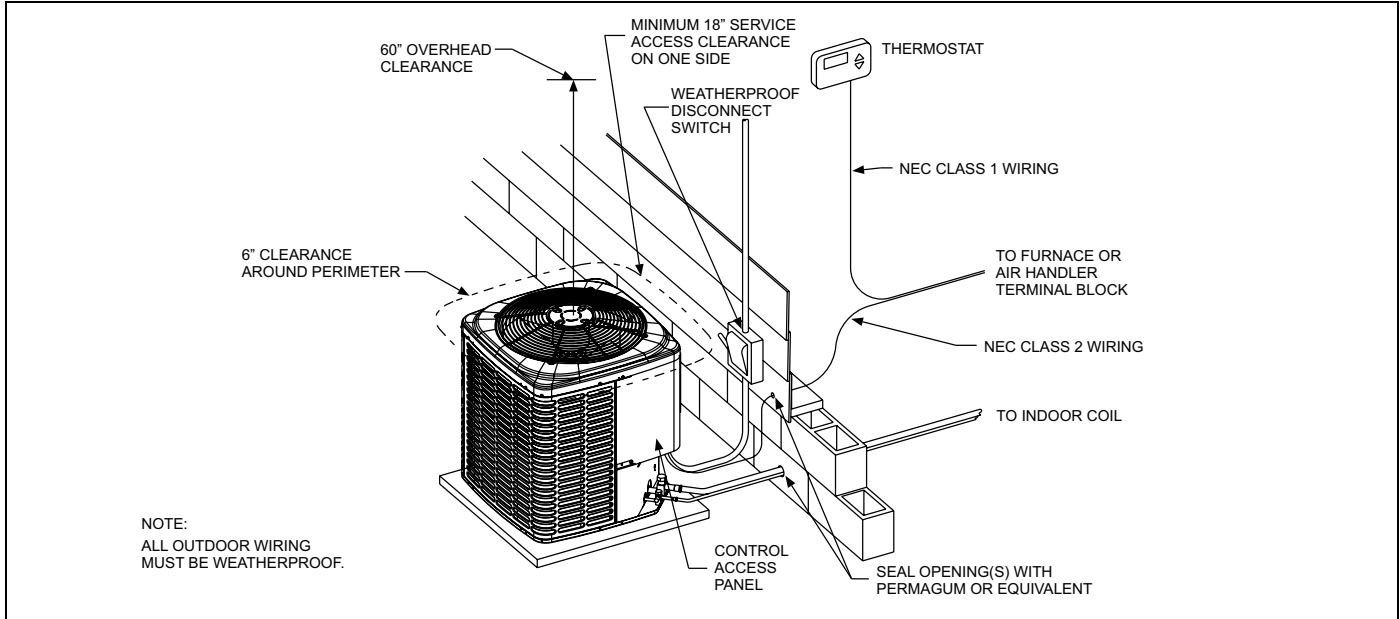

TYPICAL FIELD WIRING

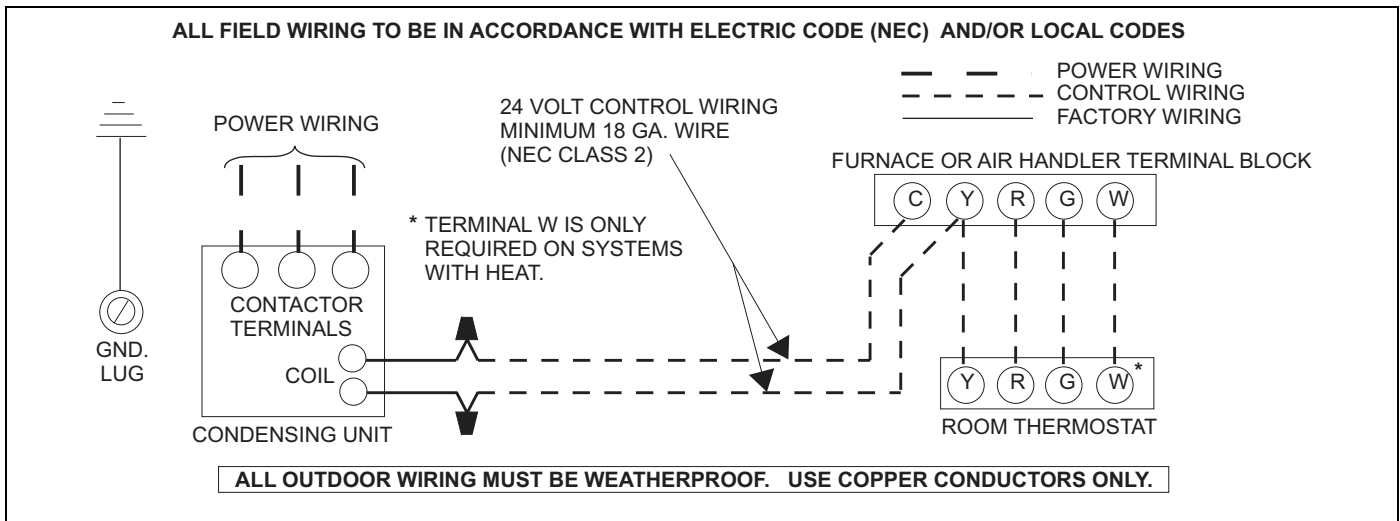

| COOLING PERFORMANCE DATA | | | | | | | | | | | | | | | | |
|--|-------------------|------------------------|------|------|------|------|-------------|------|------|------|------|-------------|------|------|------|------|
| AIR CONDITIONER MODEL NO. | | YCJD30S4(3,4)S3 | | | | | | | | | | | | | | |
| INDOOR COIL MODEL NO. | | FC/MC/PC35 | | | | | | | | | | | | | | |
| CONDENSING ENTERING AIR TEMPERATURE | IDCFM | 800 | | | | | 1000 | | | | | 1200 | | | | |
| | ID DB (°F) | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 |
| | ID WB (°F) | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 |
| 65 | T.C. | 28.4 | 31.4 | 30.8 | 33.1 | 34.4 | 29.8 | 31.8 | 31.4 | 33.4 | 34.5 | 31.2 | 32.3 | 32.1 | 33.7 | 34.7 |
| | S.C. | 28.8 | 25.8 | 21.7 | 21.2 | 16.0 | 30.4 | 28.2 | 23.6 | 22.6 | 17.1 | 31.9 | 30.7 | 25.4 | 24.0 | 18.1 |
| | KW | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 | 1.7 |
| 75 | T.C. | 26.4 | 28.8 | 28.2 | 30.9 | 32.6 | 27.9 | 29.7 | 28.9 | 31.4 | 32.8 | 29.5 | 30.5 | 29.6 | 31.8 | 32.9 |
| | S.C. | 26.9 | 24.7 | 20.5 | 20.3 | 15.4 | 28.5 | 27.1 | 22.6 | 22.0 | 16.4 | 30.2 | 29.5 | 24.6 | 23.7 | 17.5 |
| | KW | 1.8 | 1.8 | 1.8 | 1.9 | 1.9 | 1.8 | 1.8 | 1.8 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 | 1.9 |
| 85 | T.C. | 24.4 | 26.3 | 25.6 | 28.8 | 30.9 | 26.0 | 27.5 | 26.4 | 29.3 | 31.0 | 27.7 | 28.7 | 27.1 | 29.8 | 31.2 |
| | S.C. | 24.9 | 23.6 | 19.4 | 19.4 | 14.7 | 26.6 | 26.0 | 21.6 | 21.4 | 15.8 | 28.4 | 28.4 | 23.9 | 23.4 | 16.8 |
| | KW | 2.0 | 2.0 | 2.0 | 2.0 | 2.1 | 2.0 | 2.0 | 2.0 | 2.0 | 2.1 | 2.0 | 2.0 | 2.0 | 2.1 | 2.1 |
| 95 | T.C. | 22.4 | 23.8 | 23.0 | 26.7 | 29.1 | 24.2 | 25.3 | 23.8 | 29.0 | 29.3 | 26.0 | 26.9 | 24.7 | 27.9 | 29.4 |
| | S.C. | 22.9 | 22.5 | 18.2 | 18.5 | 14.1 | 24.8 | 24.9 | 20.7 | 21.2 | 15.1 | 26.7 | 27.3 | 23.1 | 23.1 | 16.2 |
| | KW | 2.1 | 2.1 | 2.1 | 2.2 | 2.3 | 2.2 | 2.2 | 2.2 | 2.2 | 2.3 | 2.2 | 2.2 | 2.2 | 2.2 | 2.3 |
| 105 | T.C. | 20.5 | 21.8 | 20.4 | 23.7 | 26.3 | 22.0 | 23.1 | 21.3 | 24.3 | 26.4 | 23.6 | 24.5 | 22.1 | 24.8 | 26.4 |
| | S.C. | 21.0 | 20.7 | 17.1 | 17.4 | 13.2 | 22.6 | 22.7 | 19.1 | 19.7 | 14.3 | 24.3 | 24.7 | 21.0 | 22.0 | 15.4 |
| | KW | 2.3 | 2.3 | 2.3 | 2.4 | 2.4 | 2.4 | 2.4 | 2.3 | 2.4 | 2.5 | 2.4 | 2.4 | 2.3 | 2.4 | 2.5 |
| 115 | T.C. | 18.6 | 19.8 | 17.9 | 20.9 | 23.5 | 19.9 | 21.0 | 18.8 | 21.4 | 23.5 | 21.2 | 22.2 | 19.6 | 21.8 | 23.6 |
| | S.C. | 19.1 | 18.9 | 15.9 | 16.4 | 12.3 | 20.5 | 20.5 | 17.5 | 18.6 | 13.5 | 22.0 | 22.2 | 19.1 | 20.9 | 14.7 |
| | KW | 2.5 | 2.5 | 2.4 | 2.5 | 2.6 | 2.5 | 2.5 | 2.5 | 2.5 | 2.6 | 2.6 | 2.6 | 2.5 | 2.6 | 2.6 |
| 125 | T.C. | 16.8 | 17.9 | 15.4 | 18.1 | 20.7 | 17.8 | 18.9 | 16.2 | 18.5 | 20.7 | 18.9 | 19.9 | 17.1 | 18.8 | 20.7 |
| | S.C. | 17.3 | 17.2 | 14.8 | 15.3 | 11.4 | 18.4 | 18.4 | 16.0 | 17.6 | 12.6 | 19.6 | 19.6 | 17.1 | 19.8 | 13.9 |
| | KW | 2.7 | 2.7 | 2.6 | 2.7 | 2.8 | 2.7 | 2.7 | 2.6 | 2.7 | 2.8 | 2.7 | 2.7 | 2.7 | 2.7 | 2.8 |

NOTE: ALL CAPACITIES INCLUDE INDOOR FAN HEAT AT 1250 BTUH/1000 CFM.

Multipliers for determining the performance with other indoor sections.

NOTE: For dry bulb temperatures different than those listed (between 73-87 F), sensible capacity increases by 1060 BTUH per 1000 CFM per degree above the listed temperature and decreases by 1060 BTUH per 1000 CFM per degree below the listed temperature.

| Air Handlers | Coils | T.C. | S.C. | KW |
|---------------------|--------------|-------------|-------------|-----------|
| – | FC/MC/PC35 | 1.00 | 1.00 | 1.00 |
| – | FC/MC/PC37 | 1.00 | 1.00 | 1.00 |
| – | FC/MC/PC43 | 1.00 | 1.00 | 1.00 |
| – | HC36 | 1.00 | 1.00 | 1.00 |
| – | HC42 | 1.00 | 1.00 | 1.00 |
| AHP30 | – | 1.00 | 1.00 | 1.00 |
| AHP36 | – | 1.00 | 1.00 | 1.00 |
| AHX30 | – | 1.01 | 1.06 | 0.95 |
| AHX36 | – | 1.03 | 1.06 | 0.95 |
| AV*36 | – | 1.03 | 1.04 | 0.95 |
| MA12B | FC/MC35B | 1.00 | 1.00 | 1.00 |
| MA12B | FC/MC43B | 1.00 | 1.00 | 1.00 |
| F4FP040 | – | 1.00 | 1.00 | 1.00 |
| F6FP030 | – | 1.01 | 1.03 | 0.97 |
| F6FP036 | – | 1.01 | 1.02 | 0.93 |

| Furnaces | Coils | T.C. | S.C. | KW |
|-----------------|--------------|-------------|-------------|-----------|
| T*(8,L)X*A12 | FC/MC/PC32A | 1.01 | 1.02 | 1.01 |
| T*(8,L)X*B12 | FC/MC/PC35B | 1.03 | 1.09 | 0.99 |
| T*(8,L)X*C16 | FC/MC/PC35C | 1.03 | 1.09 | 0.95 |
| T*(8,L)X*C20 | FC/MC/PC35C | 0.99 | 0.98 | 0.91 |
| T*9X*B12 | FC/MC/PC35B | 1.03 | 1.09 | 0.94 |
| T*9X*C16 | FC/MC/PC35C | 1.03 | 1.07 | 0.94 |
| T*(8,L)X*A12 | FC/MC/PC37A | 1.03 | 1.09 | 0.99 |
| T*(8,L)X*B12 | FC/MC/PC43B | 1.03 | 1.09 | 0.95 |
| T*(8,L)X*C16 | FC/MC/PC43C | 0.97 | 0.92 | 0.89 |
| T*(8,L)X*C20 | FC/MC/PC43C | 1.02 | 1.01 | 0.94 |
| T*9X*B12 | FC/MC/PC43B | 1.03 | 1.09 | 0.99 |
| T*9X*C16 | FC/MC/PC43C | 1.03 | 1.09 | 0.95 |
| T*9X*C20 | FC/MC/PC43C | 0.97 | 0.92 | 0.89 |

| COOLING PERFORMANCE DATA | | | | | | | | | | | | | | | | |
|--|------------|------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| AIR CONDITIONER MODEL NO. | | YCJD36S4(3,4)S3 | | | | | | | | | | | | | | |
| INDOOR COIL MODEL NO. | | FC/MC/PC43 | | | | | | | | | | | | | | |
| CONDENSING ENTERING AIR TEMPERATURE | IDCFM | 1000 | | | | | 1200 | | | | | 1400 | | | | |
| | ID DB (°F) | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 |
| | ID WB (°F) | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 |
| 65 | T.C. | 34.7 | 36.1 | 35.2 | 37.4 | 37.3 | 33.8 | 35.5 | 34.8 | 37.0 | 37.5 | 32.9 | 34.9 | 34.4 | 36.6 | 37.6 |
| | S.C. | 34.3 | 33.0 | 27.6 | 25.5 | 18.4 | 33.3 | 31.0 | 26.2 | 24.6 | 18.0 | 32.3 | 29.1 | 24.7 | 23.6 | 17.7 |
| | KW | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 2.0 | 1.9 | 2.0 | 1.9 | 2.0 | 2.0 |
| 75 | T.C. | 33.6 | 34.7 | 33.6 | 35.9 | 36.6 | 32.6 | 33.9 | 33.2 | 35.5 | 36.6 | 31.5 | 33.2 | 32.7 | 35.1 | 36.6 |
| | S.C. | 33.3 | 32.5 | 27.5 | 25.6 | 18.6 | 32.1 | 30.6 | 25.8 | 24.5 | 18.0 | 31.0 | 28.7 | 24.2 | 23.3 | 17.5 |
| | KW | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.1 | 2.2 | 2.2 | 2.2 | 2.2 |
| 85 | T.C. | 32.4 | 33.2 | 32.0 | 34.4 | 35.8 | 31.3 | 32.3 | 31.5 | 34.1 | 35.7 | 30.2 | 31.5 | 31.0 | 33.7 | 35.5 |
| | S.C. | 32.2 | 32.0 | 27.3 | 25.8 | 18.8 | 30.9 | 30.2 | 25.5 | 24.3 | 18.0 | 29.6 | 28.3 | 23.7 | 22.9 | 17.3 |
| | KW | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.4 | 2.3 | 2.4 | 2.4 | 2.4 | 2.4 |
| 95 | T.C. | 31.3 | 31.7 | 30.4 | 33.0 | 35.0 | 30.1 | 30.7 | 29.9 | 35.0 | 34.8 | 28.9 | 29.8 | 29.4 | 32.2 | 34.5 |
| | S.C. | 31.1 | 31.5 | 27.2 | 26.0 | 19.0 | 29.7 | 29.7 | 25.2 | 24.9 | 18.0 | 28.3 | 27.9 | 23.2 | 22.5 | 17.1 |
| | KW | 2.6 | 2.6 | 2.6 | 2.6 | 2.7 | 2.6 | 2.6 | 2.6 | 2.6 | 2.7 | 2.5 | 2.6 | 2.6 | 2.6 | 2.6 |
| 105 | T.C. | 27.9 | 28.8 | 27.2 | 29.8 | 32.5 | 27.0 | 27.8 | 26.6 | 29.4 | 32.2 | 26.0 | 26.9 | 25.9 | 29.0 | 31.9 |
| | S.C. | 28.7 | 28.9 | 25.0 | 25.0 | 18.4 | 27.3 | 27.2 | 23.2 | 23.2 | 17.3 | 25.8 | 25.6 | 21.5 | 21.4 | 16.2 |
| | KW | 2.8 | 2.8 | 2.8 | 2.8 | 2.9 | 2.8 | 2.8 | 2.8 | 2.8 | 2.9 | 2.7 | 2.8 | 2.7 | 2.8 | 2.9 |
| 115 | T.C. | 24.6 | 26.0 | 24.2 | 26.8 | 30.1 | 23.9 | 25.1 | 23.4 | 26.3 | 29.8 | 23.3 | 24.1 | 22.6 | 25.9 | 29.5 |
| | S.C. | 26.3 | 26.3 | 22.8 | 24.1 | 17.8 | 24.9 | 24.8 | 21.3 | 22.2 | 16.6 | 23.5 | 23.3 | 19.8 | 20.3 | 15.4 |
| | KW | 3.0 | 3.0 | 3.0 | 3.0 | 3.1 | 3.0 | 3.0 | 2.9 | 3.0 | 3.1 | 2.9 | 2.9 | 2.9 | 3.0 | 3.1 |
| 125 | T.C. | 21.3 | 23.2 | 21.1 | 23.7 | 27.6 | 20.9 | 22.3 | 20.2 | 23.2 | 27.3 | 20.5 | 21.3 | 19.3 | 22.7 | 27.0 |
| | S.C. | 23.9 | 23.8 | 20.6 | 23.2 | 17.2 | 22.5 | 22.4 | 19.4 | 21.2 | 15.9 | 21.1 | 21.0 | 18.2 | 19.2 | 14.6 |
| | KW | 3.2 | 3.2 | 3.2 | 3.2 | 3.4 | 3.2 | 3.2 | 3.1 | 3.2 | 3.3 | 3.1 | 3.1 | 3.1 | 3.2 | 3.3 |

NOTE: ALL CAPACITIES INCLUDE INDOOR FAN HEAT AT 1250 BTUH/1000 CFM.

Multipliers for determining the performance with other indoor sections.

NOTE: For dry bulb temperatures different than those listed (between 73-87 F), sensible capacity increases by 1060 BTUH per 1000 CFM per degree above the listed temperature and decreases by 1060 BTUH per 1000 CFM per degree below the listed temperature.

| Air Handlers | Coils | T.C. | S.C. | KW |
|---------------------|--------------|-------------|-------------|-----------|
| - | FC/MC/PC43 | 1.00 | 1.00 | 1.00 |
| - | FC/MC/PC48 | 1.00 | 1.00 | 1.00 |
| - | HC42 | 1.00 | 1.00 | 1.00 |
| - | UC48 | 1.00 | 1.00 | 1.00 |
| AHP36 | - | 1.00 | 1.00 | 1.00 |
| AHP42 | - | 1.00 | 1.00 | 1.00 |
| AHX36 | - | 1.01 | 1.01 | 0.96 |
| AHX42 | - | 1.01 | 1.02 | 0.94 |
| AV*36 | - | 1.01 | 1.01 | 0.92 |
| MA12B | FC/MC43B | 1.00 | 1.00 | 1.00 |
| MA14D | FC/MC48D | 1.00 | 1.00 | 1.00 |
| F5FP048 | - | 1.00 | 1.00 | 1.00 |
| F6FP042 | - | 1.02 | 1.04 | 0.98 |

| Furnaces | Coils | T.C. | S.C. | KW |
|-----------------|--------------|-------------|-------------|-----------|
| T*(8,L)X*A12 | FC/MC/PC37A | 1.01 | 1.02 | 0.98 |
| T*(8,L)X*B12 | FC/MC/PC43B | 1.01 | 1.02 | 0.98 |
| T*(8,L)X*C16 | FC/MC/PC43C | 1.01 | 1.00 | 0.96 |
| T*(8,L)X*C20 | FC/MC/PC43C | 1.02 | 1.03 | 0.96 |
| T*9X*B12 | FC/MC/PC43B | 1.01 | 1.02 | 0.98 |
| T*9X*C16 | FC/MC/PC43C | 1.01 | 1.02 | 0.98 |
| T*9X*C20 | FC/MC/PC43C | 1.00 | 0.99 | 0.96 |
| T*(8,L)X*C16 | FC/MC/PC48C | 1.02 | 1.02 | 0.97 |
| T*(8,L)X*C20 | FC/MC/PC48C | 1.02 | 1.04 | 0.98 |
| T*9X*C16 | FC/MC/PC48C | 1.02 | 1.04 | 0.98 |
| T*9X*C20 | FC/MC/PC48C | 1.01 | 1.01 | 0.97 |
| T*9X*D20 | FC/MC/PC48D | 1.01 | 1.01 | 0.97 |
| T*(8,L)X*C16 | UC48C | 0.98 | 1.00 | 0.93 |
| T*(8,L)X*C20 | UC48C | 0.99 | 1.02 | 0.95 |
| T*9X*C16 | UC48C | 0.99 | 1.00 | 0.97 |
| T*9X*C20 | UC48C | 0.97 | 0.99 | 0.95 |
| T*9X*D20 | UC48D | 0.97 | 0.99 | 0.95 |

| COOLING PERFORMANCE DATA | | | | | | | | | | | | | | | | |
|--|------------|------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| AIR CONDITIONER MODEL NO. | | YCJD42S4(3,4)S3 | | | | | | | | | | | | | | |
| INDOOR COIL MODEL NO. | | FC/MC/PC43 | | | | | | | | | | | | | | |
| CONDENSING ENTERING AIR TEMPERATURE | IDCFM | 1200 | | | | | 1400 | | | | | 1600 | | | | |
| | ID DB (°F) | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 |
| | ID WB (°F) | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 |
| 65 | T.C. | 44.4 | 45.5 | 43.6 | 47.0 | 48.5 | 45.9 | 46.5 | 45.0 | 48.5 | 49.8 | 47.5 | 47.5 | 46.5 | 50.1 | 51.1 |
| | S.C. | 41.5 | 35.6 | 29.7 | 28.7 | 21.5 | 42.9 | 37.5 | 31.4 | 30.2 | 22.9 | 44.4 | 39.4 | 33.2 | 31.7 | 24.3 |
| | KW | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.6 | 2.5 | 2.5 | 2.5 | 2.5 | 2.6 |
| 75 | T.C. | 42.3 | 42.9 | 41.2 | 45.1 | 46.6 | 44.2 | 44.3 | 42.7 | 46.6 | 47.9 | 46.0 | 45.7 | 44.2 | 48.1 | 49.1 |
| | S.C. | 39.4 | 35.2 | 29.2 | 28.5 | 21.3 | 41.1 | 37.4 | 31.1 | 30.1 | 22.4 | 42.9 | 39.7 | 33.0 | 31.8 | 23.6 |
| | KW | 2.7 | 2.7 | 2.7 | 2.8 | 2.8 | 2.7 | 2.7 | 2.7 | 2.8 | 2.8 | 2.8 | 2.8 | 2.8 | 2.8 | 2.9 |
| 85 | T.C. | 40.2 | 40.3 | 38.9 | 43.3 | 44.6 | 42.4 | 42.1 | 40.4 | 44.7 | 45.9 | 44.6 | 43.9 | 41.9 | 46.0 | 47.2 |
| | S.C. | 37.2 | 34.7 | 28.7 | 28.2 | 21.2 | 39.3 | 37.3 | 30.8 | 30.0 | 22.0 | 41.5 | 40.0 | 32.9 | 31.8 | 22.9 |
| | KW | 3.0 | 3.0 | 3.0 | 3.0 | 3.1 | 3.0 | 3.0 | 3.0 | 3.1 | 3.1 | 3.0 | 3.0 | 3.0 | 3.1 | 3.1 |
| 95 | T.C. | 38.2 | 37.7 | 36.5 | 41.5 | 42.7 | 40.7 | 39.9 | 38.0 | 42.0 | 44.0 | 43.2 | 42.1 | 39.6 | 43.9 | 45.3 |
| | S.C. | 35.0 | 34.3 | 28.1 | 28.0 | 21.0 | 37.5 | 37.3 | 30.5 | 29.4 | 21.6 | 40.0 | 40.3 | 32.8 | 31.9 | 22.2 |
| | KW | 3.2 | 3.2 | 3.2 | 3.3 | 3.4 | 3.3 | 3.3 | 3.3 | 3.3 | 3.4 | 3.3 | 3.3 | 3.3 | 3.4 | 3.4 |
| 105 | T.C. | 35.3 | 34.7 | 32.8 | 37.4 | 38.7 | 37.5 | 36.7 | 34.2 | 38.6 | 39.8 | 39.8 | 38.8 | 35.6 | 39.8 | 40.9 |
| | S.C. | 32.3 | 32.1 | 26.5 | 26.4 | 19.6 | 34.5 | 34.5 | 28.8 | 28.4 | 20.4 | 36.7 | 37.0 | 31.1 | 30.5 | 21.2 |
| | KW | 3.5 | 3.5 | 3.5 | 3.6 | 3.7 | 3.5 | 3.5 | 3.5 | 3.6 | 3.7 | 3.6 | 3.6 | 3.5 | 3.6 | 3.7 |
| 115 | T.C. | 32.4 | 31.7 | 29.2 | 33.4 | 34.8 | 34.5 | 33.6 | 30.5 | 34.6 | 35.7 | 36.5 | 35.5 | 31.8 | 35.7 | 36.7 |
| | S.C. | 29.7 | 30.0 | 25.0 | 24.9 | 18.2 | 31.6 | 31.9 | 27.2 | 27.0 | 19.3 | 33.5 | 33.8 | 29.4 | 29.1 | 20.3 |
| | KW | 3.7 | 3.7 | 3.7 | 3.8 | 4.0 | 3.8 | 3.8 | 3.7 | 3.8 | 4.0 | 3.8 | 3.8 | 3.7 | 3.9 | 4.0 |
| 125 | T.C. | 29.6 | 28.8 | 25.6 | 29.4 | 30.9 | 31.4 | 30.5 | 26.8 | 30.5 | 31.7 | 33.2 | 32.2 | 28.0 | 31.7 | 32.5 |
| | S.C. | 27.1 | 27.9 | 23.5 | 23.4 | 16.8 | 28.7 | 29.3 | 25.6 | 25.6 | 18.1 | 30.2 | 30.6 | 27.6 | 27.8 | 19.4 |
| | KW | 4.0 | 4.0 | 3.9 | 4.0 | 4.2 | 4.0 | 4.0 | 4.0 | 4.1 | 4.3 | 4.1 | 4.1 | 4.0 | 4.1 | 4.3 |

NOTE: ALL CAPACITIES INCLUDE INDOOR FAN HEAT AT 1250 BTUH/1000 CFM.

Multipliers for determining the performance with other indoor sections.

NOTE: For dry bulb temperatures different than those listed (between 73-87 F), sensible capacity increases by 1060 BTUH per 1000 CFM per degree above the listed temperature and decreases by 1060 BTUH per 1000 CFM per degree below the listed temperature.

| Air Handlers | Coils | T.C. | S.C. | KW |
|---------------------|--------------|-------------|-------------|-----------|
| - | FC/MC/PC48 | 1.00 | 1.00 | 1.00 |
| - | HC42 | 1.00 | 1.00 | 1.00 |
| - | UC48 | 1.00 | 1.00 | 1.00 |
| AHP42 | - | 0.97 | 1.00 | 0.97 |
| AHX42 | - | 1.00 | 1.02 | 0.92 |
| AV*48 | - | 1.01 | 1.02 | 0.92 |
| AV*60 | - | 1.00 | 1.02 | 0.92 |
| MA16C | FC/MC43C | 1.00 | 1.00 | 1.00 |
| MA14D | FC/MC48D | 1.00 | 1.00 | 1.00 |
| MA16C | FC/MC48C | 1.00 | 1.00 | 1.00 |
| F5FP048 | - | 1.00 | 1.00 | 1.00 |
| F6FP042 | - | 1.00 | 1.03 | 0.94 |
| F6FP048 | - | 0.99 | 1.01 | 0.93 |

| Furnaces | Coils | T.C. | S.C. | KW |
|-----------------|--------------|-------------|-------------|-----------|
| T*(8,L)X*B12 | FC/MC/PC43B | 1.00 | 0.99 | 0.96 |
| T*(8,L)X*C16 | FC/MC/PC43C | 1.00 | 1.02 | 0.96 |
| T*(8,L)X*C20 | FC/MC/PC43C | 1.00 | 1.01 | 0.96 |
| T*9X*B12 | FC/MC/PC43B | 1.00 | 0.99 | 0.96 |
| T*9X*C16 | FC/MC/PC43C | 1.00 | 1.02 | 1.00 |
| T*9X*C20 | FC/MC/PC43C | 1.00 | 1.02 | 1.00 |
| T*(8,L)X*C16 | FC/MC/PC48C | 1.00 | 1.01 | 0.96 |
| T*(8,L)X*C20 | FC/MC/PC48C | 1.00 | 1.03 | 0.96 |
| T*9X*C16 | FC/MC/PC48C | 1.00 | 1.00 | 0.96 |
| T*9X*C20 | FC/MC/PC48C | 1.00 | 1.00 | 0.96 |
| T*9X*D20 | FC/MC/PC48D | 1.00 | 1.02 | 0.96 |
| T*(8,L)X*C16 | UC48C | 1.00 | 1.01 | 1.00 |
| T*(8,L)X*C20 | UC48C | 1.00 | 1.03 | 1.00 |
| T*9X*C16 | UC48C | 0.99 | 1.00 | 0.99 |
| T*9X*C20 | UC48C | 1.00 | 1.01 | 1.00 |
| T*9X*D20 | UC48D | 1.00 | 1.01 | 1.00 |

| COOLING PERFORMANCE DATA | | | | | | | | | | | | | | | | |
|--|-------------------|------------------------|------|------|------|------|-------------|------|------|------|------|-------------|------|------|------|------|
| AIR CONDITIONER MODEL NO. | | YCJD48S4(3,4)S3 | | | | | | | | | | | | | | |
| INDOOR COIL MODEL NO. | | FC/MC/PC48 | | | | | | | | | | | | | | |
| CONDENSING ENTERING AIR TEMPERATURE | IDCFM | 1400 | | | | | 1600 | | | | | 1800 | | | | |
| | ID DB (°F) | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 |
| | ID WB (°F) | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 |
| 65 | T.C. | 49.7 | 51.4 | 50.6 | 55.8 | 54.6 | 52.0 | 53.1 | 51.9 | 56.4 | 55.4 | 54.4 | 54.7 | 53.2 | 56.9 | 56.3 |
| | S.C. | 47.2 | 43.1 | 35.9 | 36.0 | 26.1 | 49.2 | 45.9 | 38.2 | 37.4 | 27.6 | 51.2 | 48.7 | 40.4 | 38.8 | 29.0 |
| | KW | 2.7 | 2.8 | 2.8 | 2.8 | 2.8 | 2.7 | 2.8 | 2.8 | 2.8 | 2.8 | 2.7 | 2.8 | 2.8 | 2.8 | 2.9 |
| 75 | T.C. | 47.5 | 48.6 | 47.7 | 52.9 | 52.4 | 49.8 | 50.3 | 48.9 | 53.6 | 53.1 | 52.0 | 52.1 | 50.2 | 54.3 | 53.8 |
| | S.C. | 44.9 | 42.0 | 35.0 | 34.9 | 25.4 | 47.0 | 44.8 | 37.1 | 36.5 | 26.8 | 49.0 | 47.6 | 39.3 | 38.2 | 28.1 |
| | KW | 3.0 | 3.0 | 3.0 | 3.1 | 3.1 | 3.0 | 3.0 | 3.0 | 3.1 | 3.2 | 3.0 | 3.0 | 3.0 | 3.1 | 3.2 |
| 85 | T.C. | 45.4 | 45.8 | 44.8 | 49.9 | 50.2 | 47.5 | 47.6 | 46.0 | 50.8 | 50.8 | 49.7 | 49.4 | 47.1 | 51.7 | 51.4 |
| | S.C. | 42.7 | 41.0 | 34.0 | 33.8 | 24.8 | 44.7 | 43.7 | 36.1 | 35.7 | 26.0 | 46.8 | 46.5 | 38.2 | 37.6 | 27.2 |
| | KW | 3.2 | 3.3 | 3.3 | 3.4 | 3.4 | 3.3 | 3.3 | 3.3 | 3.4 | 3.5 | 3.3 | 3.3 | 3.3 | 3.4 | 3.5 |
| 95 | T.C. | 43.2 | 42.9 | 42.0 | 47.0 | 47.9 | 45.3 | 44.9 | 43.1 | 48.0 | 48.4 | 47.4 | 46.8 | 44.1 | 49.1 | 48.9 |
| | S.C. | 40.4 | 39.9 | 33.0 | 32.7 | 24.1 | 42.4 | 42.6 | 35.1 | 34.6 | 25.2 | 44.5 | 45.4 | 37.1 | 37.0 | 26.3 |
| | KW | 3.5 | 3.5 | 3.5 | 3.6 | 3.7 | 3.6 | 3.6 | 3.5 | 3.7 | 3.8 | 3.6 | 3.6 | 3.6 | 3.7 | 3.8 |
| 105 | T.C. | 39.8 | 39.4 | 37.3 | 42.4 | 43.6 | 41.6 | 41.1 | 38.4 | 43.4 | 44.0 | 43.5 | 42.9 | 39.5 | 44.4 | 44.5 |
| | S.C. | 37.1 | 37.0 | 30.9 | 30.9 | 22.9 | 38.9 | 39.3 | 32.9 | 33.0 | 23.9 | 40.8 | 41.5 | 34.9 | 35.1 | 25.0 |
| | KW | 3.8 | 3.8 | 3.8 | 3.9 | 4.0 | 3.9 | 3.9 | 3.8 | 3.9 | 4.1 | 3.9 | 3.9 | 3.8 | 4.0 | 4.1 |
| 115 | T.C. | 36.5 | 35.9 | 32.7 | 38.0 | 39.3 | 38.1 | 37.5 | 33.9 | 38.9 | 39.8 | 39.7 | 39.1 | 35.1 | 39.8 | 40.2 |
| | S.C. | 33.9 | 34.2 | 28.9 | 29.2 | 21.6 | 35.5 | 36.0 | 30.9 | 31.3 | 22.7 | 37.2 | 37.7 | 32.8 | 33.3 | 23.8 |
| | KW | 4.1 | 4.1 | 4.0 | 4.2 | 4.3 | 4.1 | 4.1 | 4.1 | 4.2 | 4.4 | 4.2 | 4.2 | 4.1 | 4.2 | 4.4 |
| 125 | T.C. | 33.1 | 32.4 | 28.1 | 33.5 | 35.1 | 34.5 | 33.8 | 29.4 | 34.4 | 35.5 | 35.9 | 35.3 | 30.6 | 35.2 | 36.0 |
| | S.C. | 30.7 | 31.4 | 26.9 | 27.5 | 20.4 | 32.1 | 32.7 | 28.8 | 29.6 | 21.5 | 33.5 | 34.0 | 30.7 | 31.6 | 22.5 |
| | KW | 4.4 | 4.4 | 4.3 | 4.4 | 4.6 | 4.4 | 4.4 | 4.3 | 4.5 | 4.7 | 4.5 | 4.5 | 4.4 | 4.5 | 4.7 |

NOTE: ALL CAPACITIES INCLUDE INDOOR FAN HEAT AT 1250 BTUH/1000 CFM.

Multipliers for determining the performance with other indoor sections.

NOTE: For dry bulb temperatures different than those listed (between 73-87 F), sensible capacity increases by 1060 BTUH per 1000 CFM per degree above the listed temperature and decreases by 1060 BTUH per 1000 CFM per degree below the listed temperature.

| Air Handlers | Coils | T.C. | S.C. | KW |
|---------------------|--------------|-------------|-------------|-----------|
| - | FC/MC/PC60 | 1.00 | 1.00 | 1.00 |
| - | HC60 | 1.00 | 1.00 | 1.00 |
| - | UC48 | 1.00 | 1.00 | 1.00 |
| - | UC60 | 1.00 | 1.00 | 1.00 |
| AHP/SHP48 | - | 1.00 | 1.00 | 1.00 |
| AHP/SHP60 | - | 1.00 | 1.01 | 1.00 |
| AHX48 | - | 1.00 | 1.03 | 0.96 |
| AV*48 | - | 1.00 | 1.03 | 0.96 |
| AV*60 | - | 1.00 | 1.01 | 0.91 |
| MA16C | FC/MC48C | 1.00 | 1.00 | 1.00 |
| MA20D | FC/MC48D | 1.00 | 1.00 | 1.00 |
| MA16C | FC60C | 1.00 | 1.00 | 1.00 |
| MA20D | FC/MC60D | 1.00 | 1.00 | 1.00 |
| F5FP048 | - | 1.00 | 1.00 | 1.00 |
| F5FP060 | - | 1.00 | 1.00 | 1.00 |

| | | | | |
|---------|---|------|------|------|
| F6FP048 | - | 0.98 | 1.01 | 0.95 |
|---------|---|------|------|------|

| Furnaces | Coils | T.C. | S.C. | KW |
|-----------------|--------------|-------------|-------------|-----------|
| T*(8,L)X*C16 | FC/MC/PC48C | 1.00 | 1.00 | 1.00 |
| T*(8,L)X*C20 | FC/MC/PC48C | 1.00 | 1.00 | 1.00 |
| T*9X*C16 | FC/MC/PC48C | 1.00 | 1.01 | 1.00 |
| T*9X*C20 | FC/MC/PC48C | 1.00 | 1.00 | 1.00 |
| T*9X*D20 | FC/MC/PC48D | 1.00 | 1.01 | 1.00 |
| T*(8,L)X*C16 | FC/PC60C | 1.00 | 1.01 | 1.00 |
| T*(8,L)X*C20 | FC/MC/PC60D | 1.00 | 1.01 | 1.00 |
| T*9X*C16 | FC/PC60C | 1.00 | 1.01 | 1.00 |
| T*9X*C20 | FC/PC60C | 0.98 | 1.01 | 0.98 |
| T*9X*D20 | FC/MC/PC60D | 0.99 | 0.98 | 0.99 |
| T*9X*C16 | FC/PC60C | 0.98 | 0.98 | 0.98 |
| T*9X*C20 | FC/PC60C | 0.98 | 0.98 | 0.98 |

| COOLING PERFORMANCE DATA | | | | | | | | | | | | | | | | |
|--|------------|------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| AIR CONDITIONER MODEL NO. | | YCJD60S4(3,4)S3 | | | | | | | | | | | | | | |
| INDOOR COIL MODEL NO. | | FC/MC/PC60 | | | | | | | | | | | | | | |
| CONDENSING ENTERING AIR TEMPERATURE | IDCFM | 1400 | | | | | 1600 | | | | | 1800 | | | | |
| | ID DB (°F) | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 | 80 | 80 | 75 | 80 | 80 |
| | ID WB (°F) | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 | 57 | 62 | 62 | 67 | 72 |
| 65 | T.C. | 55.8 | 63.8 | 62.1 | 65.2 | 71.9 | 60.3 | 65.7 | 62.8 | 66.7 | 69.8 | 64.8 | 67.5 | 63.5 | 68.2 | 67.8 |
| | S.C. | 54.7 | 51.6 | 41.4 | 41.1 | 34.1 | 58.4 | 54.2 | 43.9 | 42.6 | 31.9 | 62.1 | 56.8 | 46.5 | 44.2 | 29.6 |
| | KW | 3.0 | 3.0 | 3.0 | 3.1 | 3.1 | 3.0 | 3.0 | 3.0 | 3.1 | 3.1 | 3.0 | 3.1 | 3.0 | 3.1 | 3.1 |
| 75 | T.C. | 56.9 | 61.1 | 58.9 | 62.7 | 69.7 | 59.2 | 63.0 | 59.9 | 64.3 | 67.9 | 61.4 | 64.9 | 61.0 | 65.9 | 66.0 |
| | S.C. | 53.9 | 50.4 | 40.5 | 40.0 | 33.5 | 55.8 | 53.1 | 43.1 | 41.8 | 31.5 | 57.7 | 55.7 | 45.6 | 43.6 | 29.5 |
| | KW | 3.4 | 3.5 | 3.5 | 3.5 | 3.6 | 3.4 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 | 3.5 |
| 85 | T.C. | 58.0 | 58.4 | 55.7 | 60.3 | 67.6 | 58.0 | 60.4 | 57.1 | 61.9 | 65.9 | 58.1 | 62.4 | 58.5 | 63.6 | 64.1 |
| | S.C. | 53.2 | 49.3 | 39.7 | 39.0 | 32.9 | 53.3 | 52.0 | 42.2 | 41.0 | 31.2 | 53.4 | 54.7 | 44.8 | 42.9 | 29.4 |
| | KW | 3.9 | 3.9 | 3.9 | 3.9 | 4.0 | 3.9 | 3.9 | 3.9 | 3.9 | 4.0 | 3.9 | 3.9 | 3.9 | 3.9 | 4.0 |
| 95 | T.C. | 59.1 | 55.7 | 52.5 | 56.9 | 65.5 | 56.9 | 57.8 | 54.3 | 57.0 | 63.9 | 54.7 | 59.8 | 56.0 | 61.2 | 62.2 |
| | S.C. | 52.4 | 48.1 | 38.8 | 37.9 | 32.3 | 50.7 | 50.9 | 41.4 | 38.8 | 30.8 | 49.0 | 53.6 | 43.9 | 42.3 | 29.4 |
| | KW | 4.3 | 4.3 | 4.3 | 4.4 | 4.5 | 4.3 | 4.3 | 4.3 | 4.4 | 4.4 | 4.3 | 4.3 | 4.3 | 4.4 | 4.4 |
| 105 | T.C. | 56.4 | 52.2 | 48.8 | 54.0 | 60.1 | 54.0 | 54.3 | 50.5 | 55.7 | 59.7 | 51.6 | 56.3 | 52.2 | 57.4 | 59.4 |
| | S.C. | 49.7 | 45.9 | 37.5 | 36.5 | 29.7 | 47.9 | 48.3 | 40.0 | 38.7 | 29.4 | 46.2 | 50.6 | 42.5 | 40.9 | 29.0 |
| | KW | 4.9 | 4.9 | 4.9 | 4.9 | 5.0 | 4.9 | 4.9 | 4.9 | 5.0 | 5.0 | 4.9 | 4.9 | 4.9 | 5.0 | 5.0 |
| 115 | T.C. | 53.8 | 48.8 | 45.2 | 50.2 | 54.8 | 51.2 | 50.9 | 46.8 | 51.9 | 55.7 | 48.7 | 53.0 | 48.5 | 53.6 | 56.6 |
| | S.C. | 47.1 | 43.8 | 36.2 | 35.0 | 27.3 | 45.3 | 45.7 | 38.6 | 37.3 | 27.9 | 43.5 | 47.7 | 41.1 | 39.6 | 28.6 |
| | KW | 5.5 | 5.4 | 5.4 | 5.5 | 5.6 | 5.5 | 5.5 | 5.4 | 5.5 | 5.6 | 5.4 | 5.5 | 5.4 | 5.5 | 5.6 |
| 125 | T.C. | 51.2 | 45.4 | 41.6 | 46.5 | 49.4 | 48.5 | 47.5 | 43.2 | 48.2 | 51.6 | 45.7 | 49.7 | 44.8 | 49.8 | 53.8 |
| | S.C. | 44.5 | 41.7 | 34.9 | 33.6 | 24.9 | 42.6 | 43.2 | 37.3 | 35.9 | 26.5 | 40.7 | 44.7 | 39.7 | 38.3 | 28.2 |
| | KW | 6.1 | 6.0 | 5.9 | 6.1 | 6.2 | 6.0 | 6.0 | 6.0 | 6.1 | 6.2 | 6.0 | 6.0 | 6.0 | 6.1 | 6.2 |

NOTE: ALL CAPACITIES INCLUDE INDOOR FAN HEAT AT 1250 BTUH/1000 CFM.

Multipliers for determining the performance with other indoor sections.

NOTE: For dry bulb temperatures different than those listed (between 73-87 F), sensible capacity increases by 1060 BTUH per 1000 CFM per degree above the listed temperature and decreases by 1060 BTUH per 1000 CFM per degree below the listed temperature.

| Air Handlers | Coils | T.C. | S.C. | KW |
|---------------------|--------------|-------------|-------------|-----------|
| - | FC/MC62 | 1.00 | 1.00 | 1.00 |
| - | HC60 | 1.00 | 1.00 | 1.00 |
| - | UC60 | 1.00 | 1.00 | 1.00 |
| AHP/SHP60 | - | 1.00 | 1.00 | 1.00 |
| AHX60 | - | 1.00 | 1.00 | 0.98 |
| AV*60 | - | 1.00 | 1.01 | 1.00 |
| MA20D | FC/MC60D | 1.00 | 1.00 | 1.00 |
| MA20D | FC/MC62D | 1.00 | 1.00 | 1.00 |
| F5FP060 | - | 1.00 | 1.00 | 1.00 |
| F6FP060 | - | 1.00 | 1.00 | 0.96 |

| Furnaces | Coils | T.C. | S.C. | KW |
|-----------------|--------------|-------------|-------------|-----------|
| T*(8,L)X*C16 | FC/PC60C | 0.99 | 0.98 | 0.99 |
| T*(8,L)X*C20 | FC/MC/PC60D | 1.00 | 0.98 | 1.00 |
| T*9X*C16 | FC/PC60C | 0.98 | 0.98 | 0.98 |
| T*9X*C20 | FC/PC60C | 0.98 | 0.98 | 0.98 |
| T*9X*D20 | FC/MC/PC60D | 0.99 | 0.98 | 0.99 |
| T*9X*C20 | FC/MC/PC60D | 0.99 | 0.98 | 0.99 |
| T*(8,L)X*C20 | FC/MC62D | 1.00 | 0.98 | 1.00 |
| T*(8,L)X*C16 | UC60C | 0.98 | 0.97 | 0.98 |
| T*(8,L)X*C20 | UC60D | 0.99 | 1.00 | 0.99 |
| T*9X*C16 | FC/PC60C | 0.98 | 0.97 | 0.98 |
| T*9X*C20 | FC/PC60C | 0.98 | 0.97 | 0.98 |
| T*9X*D20 | UC60D | 0.98 | 0.97 | 0.98 |
| T*(8,L)X*C20 | UC60D | 0.99 | 1.00 | 0.99 |
| T*9X*C20 | UC60D | 0.98 | 0.97 | 0.98 |

NOTES